
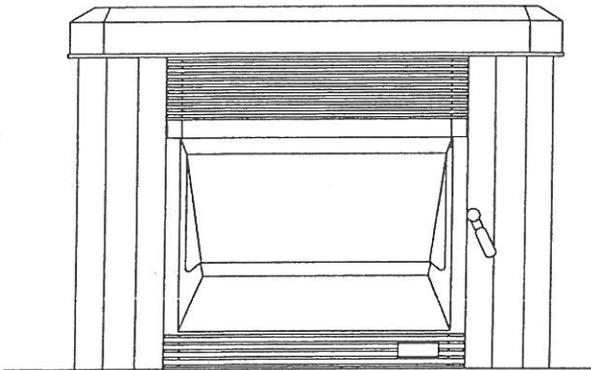
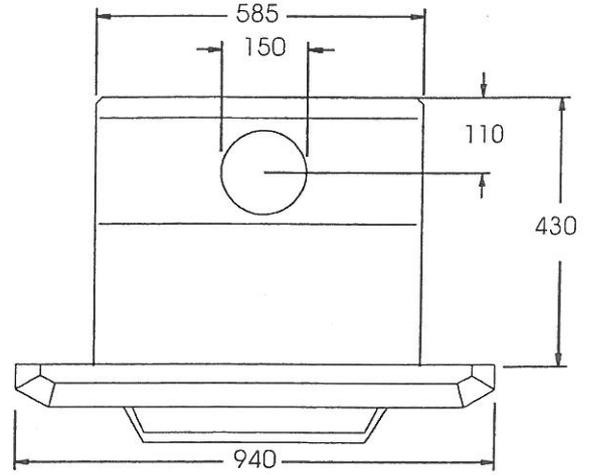


INSERT SPECIFICATIONS

MODEL: INSERT IB07

PAGE 1 OF 2

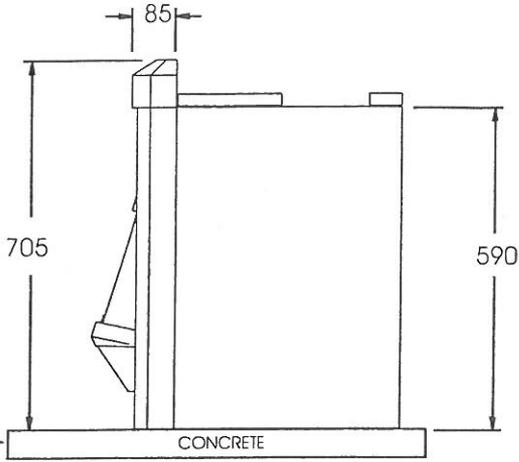

Industry Rated
Peak Output (KW)

Max Log
length

Water Heating
Option

Estimated Burn
Time on low (HRS)

21

425



8-10

TESTED AND APPROVED TO THE FOLLOWING STANDARDS


NZS 7401: 1985 - AS2918: 1987 - NZS 7403: 1993 - AS4013: 1992 (with water booster)

INSERT SPECIFICATIONS

MODEL: INSERT IB07

PAGE 2 OF 2

Typical installation shown complies with AS2918 and NZS7421 (including appendix J). The insulating blanket supplied should be installed with all units to ensure maximum performance.

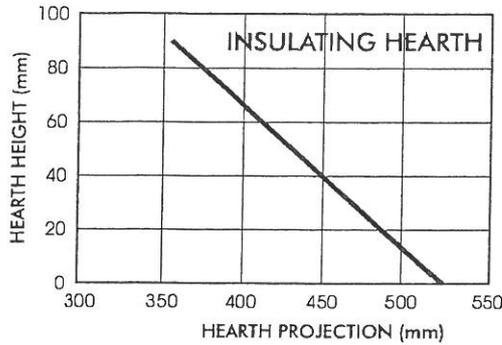

New Zealand

As per graph (Insulating Hearth)
Dimensions are taken from door seal lip (Fire Box) to the front of the hearth.

Australia

Minimum hearth from masonry opening 870mm wide extending 300 from door lip and using material as per AS2918:1990

Notes: Flue Kits (All Models)

Please follow the flue manufacturers installation instructions. The tested flue height for this unit is 4.2 metres. Deviation from this may alter the heaters performance and may nullify the Reliance Group warranty if the flue is excessively long or short. If in doubt contact your Jayline supplier.

(Seismic Restraint)

Drill through the bottom tray of the cabinet into the masonry and fit two M6 bolts or similar \varnothing as a seismic restraint.

IF THE MANTEL EXTENDS BEYOND THIS LINE A MANTEL PROTECTOR SHOULD BE FITTED

Water Booster

We recommend the use of the "Superior" 2.2 Kw Booster P/N 112687 (Tested)

