
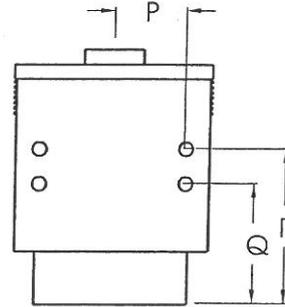
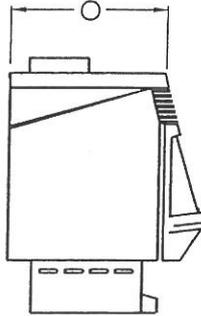


Dimensions "K & F" are taken from door seal lip (Fire Box.) to the front of the hearth.
All Dimensions in Millimetres

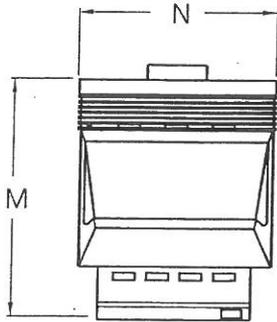

Saffire Specifications

	A	B	C	D	E	F	G	H	I	J	K	L
New Zealand with S/S Flue Screen 1200	260	60	205	700	250	200	850	290	25	860	200	410
New Zealand without Flue Screen	260	300	445	940	280	200	850	415	130	985	200	530
Australia with Flue Screen 900	240	55	200	800	280	300	860	290	25	860	300	550

	M	N	O	P	Q	R
Measurements	665	535	430	150	290	390

Industry Rated Peak Output (KW)	Max Log Length	Water Heating Option	Estimated Burn Time on low (HRS)	Insulation Hearth	Ash Hearth
15	350	✓	8-10	--	✓

TESTED AND APPROVED TO THE FOLLOWING STANDARDS


NZS 7401: 1985 - AS2918: 1987

NZS 7403:1993 - AS4013 (with water booster)

FREE STANDING SPECIFICATIONS

MODEL: SAFFIRE FS04

PAGE 2 OF 2

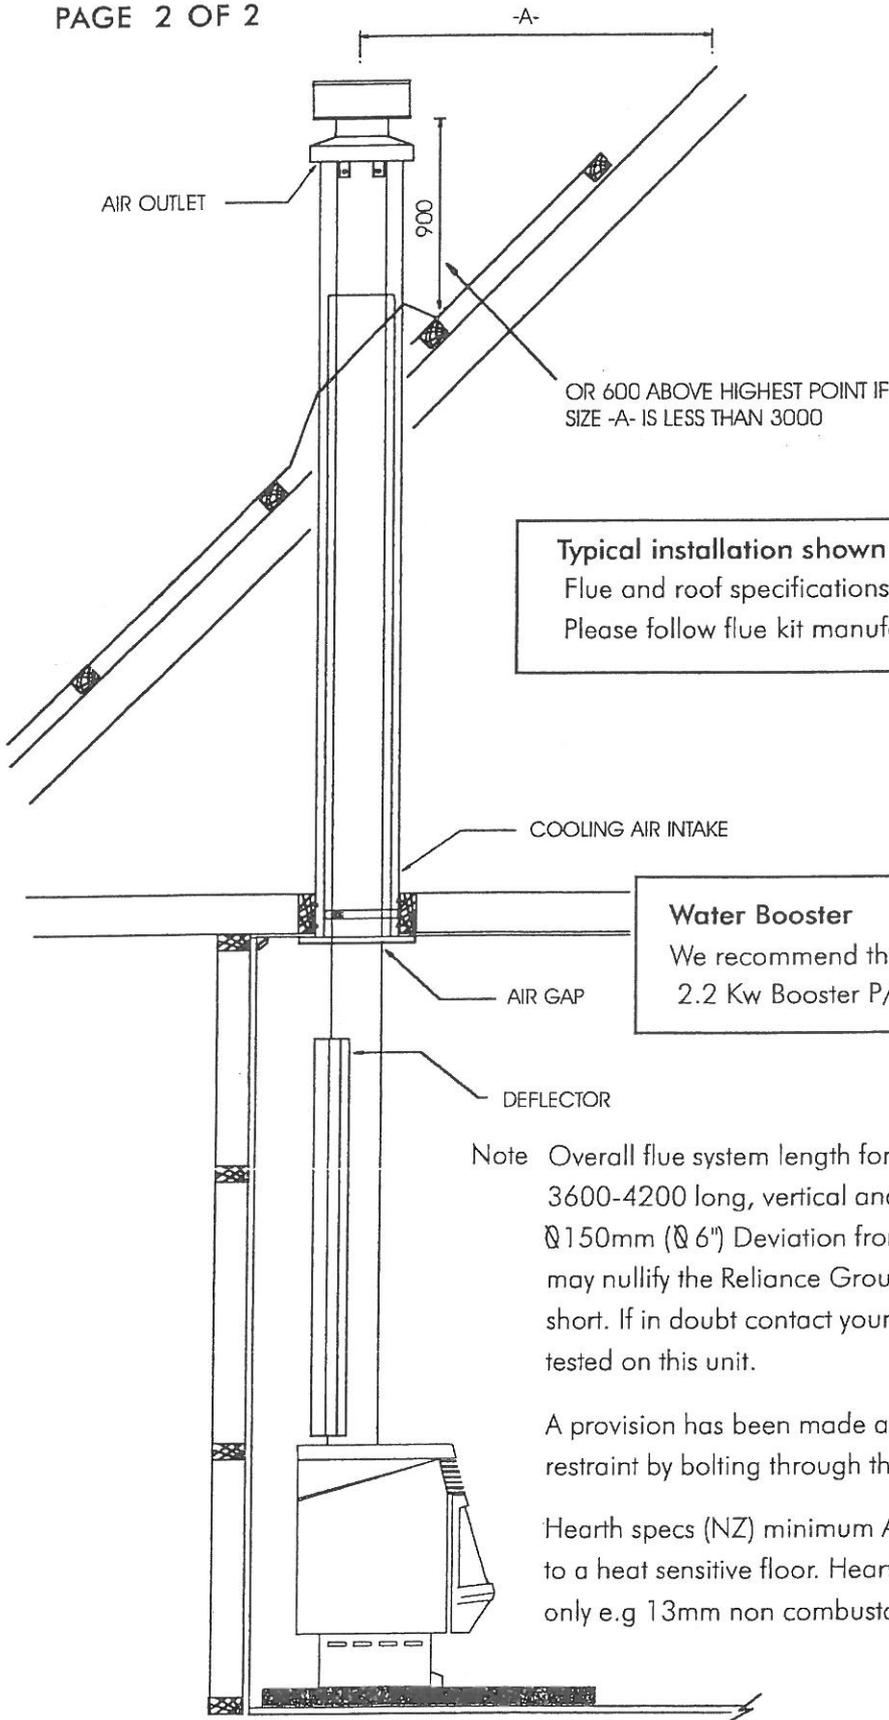

Typical installation shown complies with AS2918 and NZS7421
 Flue and roof specifications are recommendations only.
 Please follow flue kit manufacturers installation instructions.

Water Booster

We recommend the use of the "Superior"
 2.2 Kw Booster P/N 112729 (Tested with fire)

Note Overall flue system length for optimum performance should be between 3600-4200 long, vertical and have no bends. Flue pipes should be $\varnothing 150\text{mm}$ ($\varnothing 6"$) Deviation from this may alter heaters performance and may nullify the Reliance Group warranty if the flue is excessively long or short. If in doubt contact your Jayline supplier. Stainless steel deflector tested on this unit.

A provision has been made at the rear of the pedestal for seismic restraint by bolting through the two holes provided

Hearth specs (NZ) minimum Ash Hearth only e.g ceramic tiles glued to a heat sensitive floor. Hearth specs (Australia) minimum Ash Hearth only e.g 13mm non combustable fire board.