
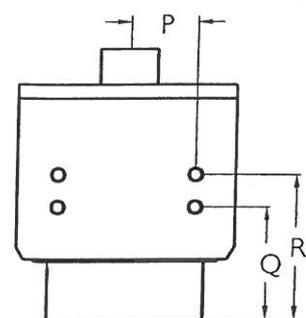
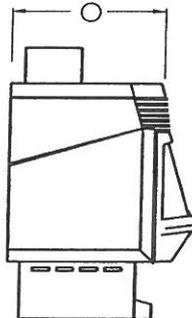


Dimensions "K & F" are taken from door seal lip (Fire Box.) to the front of the hearth.  
All Dimensions in Millimetres

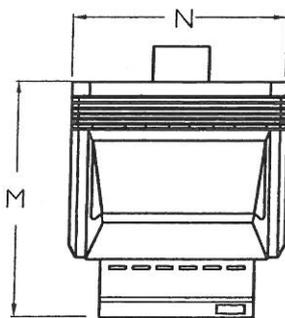

### Spitfire Specifications

	A	B	C	D	E	F	G	H	I	J	K	L
New Zealand with S/S Flue Screen 1200	340	120	260	750	250	200	850	325	10	900	200	440
New Zealand without Flue Screen	340	330	470	1060	400	200	850	445	130	1070	200	670
Australia with Flue Screen 900	320	120	260	850	400	300	850	325	10	950	300	550

	M	N	O	P	Q	R
Measurements	675	615	440	200	320	420

Industry Rated Peak Output (KW)	Max Log Length	Water Heating Option	Estimated Burn Time on low (HRS)	Insulation Hearth	Ash Hearth
21	425	✓	8-10	--	✓


### TESTED AND APPROVED TO THE FOLLOWING STANDARDS

NZS 7401: 1985 - AS2918: 1987. NZS7403: 1993 - AS4013 (with water booster)

## FREE STANDING SPECIFICATIONS

MODEL: SPITFIRE FS10

PAGE 2 OF 2

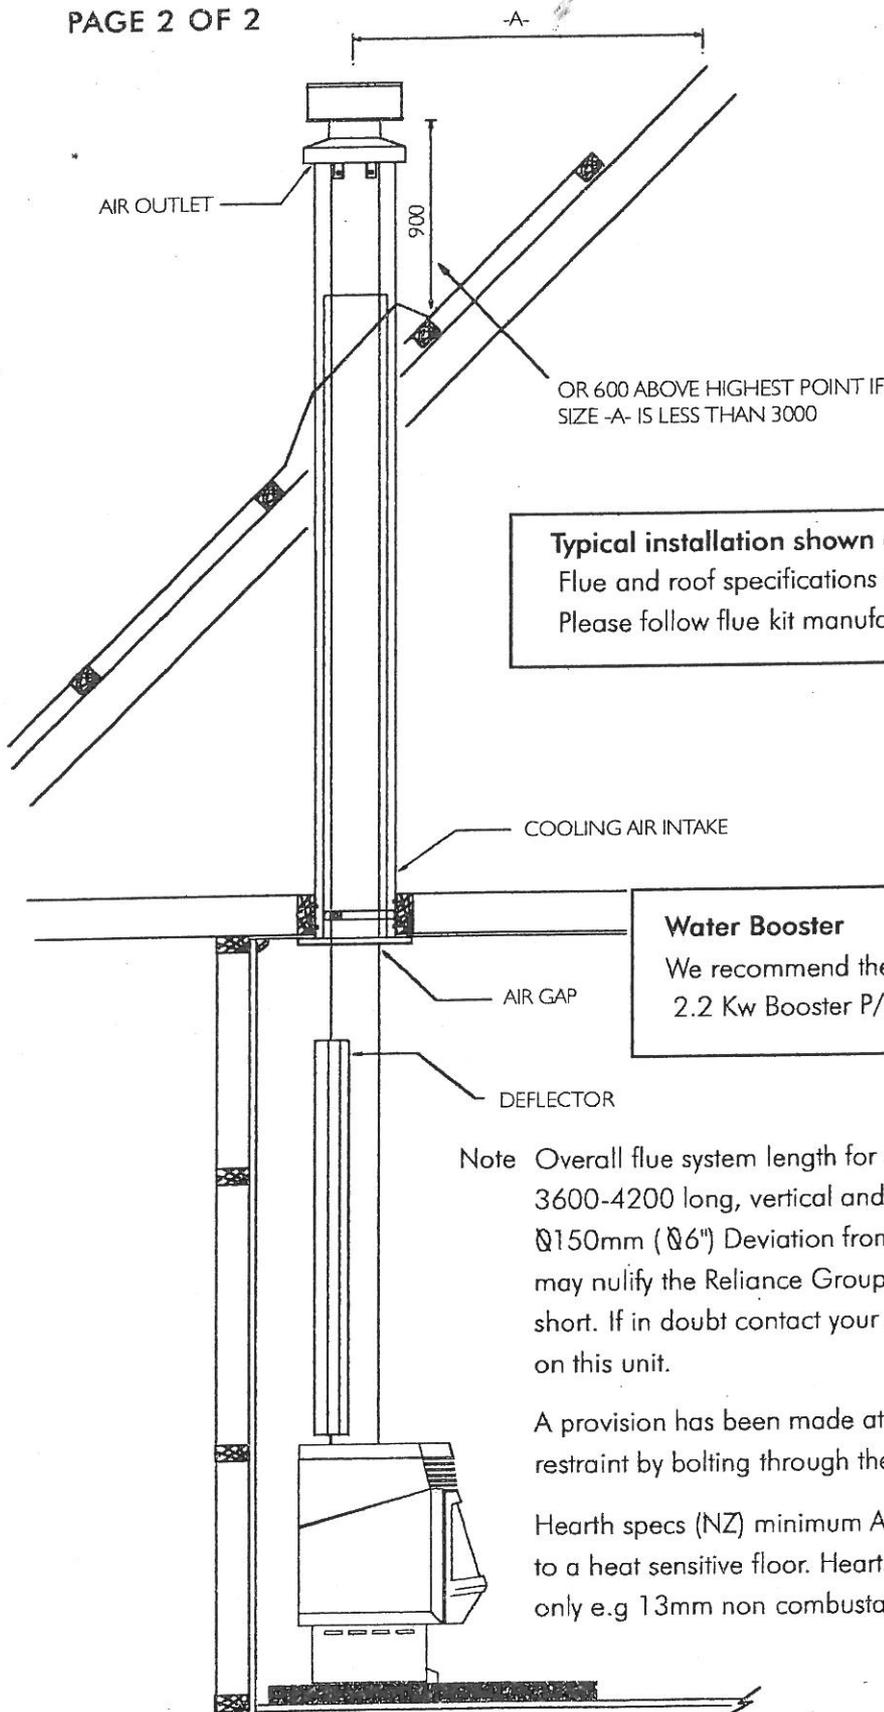

**Typical installation shown complies with AS2918 and NZS7421**  
 Flue and roof specifications are recommendations only.  
 Please follow flue kit manufacturers installation instructions.

### Water Booster

We recommend the use of the "Superior"  
 2.2 Kw Booster P/N 112936 (Tested with fire)

**Note** Overall flue system length for optimum performance should be between 3600-4200 long, vertical and have no bends. Flue pipes should be  $\varnothing 150\text{mm}$  ( $\varnothing 6"$ ) Deviation from this may alter heaters performance and may nullify the Reliance Group warranty if the flue is excessively long or short. If in doubt contact your Jayline supplier. Stainless steel deflector tested on this unit.

A provision has been made at the rear of the pedestal for seismic restraint by bolting through the two holes provided

Hearth specs (NZ) minimum Ash Hearth only e.g ceramic tiles glued to a heat sensitive floor. Hearth specs (Australia) minimum Ash Hearth only e.g 13mm non combustable fire board.