




Dimension "C" is taken from door seal lip (Fire Box.) to the front of the hearth.  
All Dimensions in Millimetres



### Spitfire Specifications

	A	B	C	E	F	G	H	I	J	K
New Zealand with S/S Flue Screen 1200	100	200	300	25	255	525	350	900	810	1000

	L	M	N	O	P	Q
Measurements	715	650	410	150	320	495

NZHHA tested Maximum Output (KW)	Industry Rated Peak Output (KW)	Water Heating Option	Estimated Burn Time on low (HRS)	Ash Hearth
14.4	20	✓	8-10	✓


TESTED AND APPROVED TO THE FOLLOWING STANDARDS

NZS 7421 / AS/NZS 2918

**INSERT SPECIFICATIONS**

**MODEL: SPITFIRE**

PAGE 2 OF 2

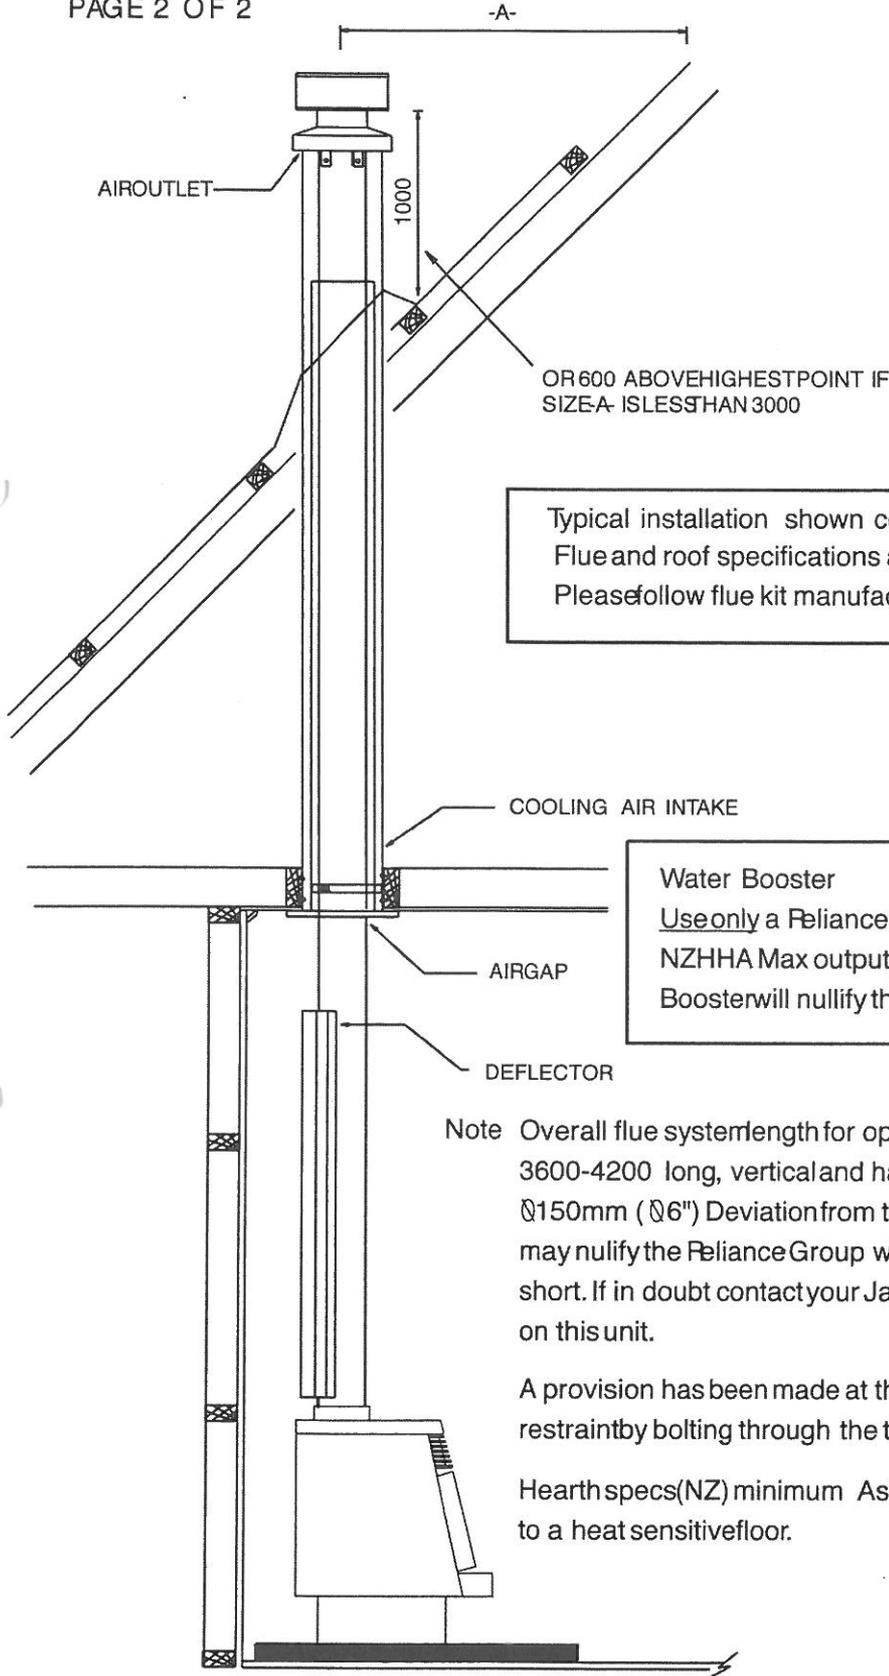

Typical installation shown complies with AS/NZS 2918  
Flue and roof specifications are recommendations only.  
Please follow flue kit manufacturers installation instructions.

**Water Booster**  
Use only a Reliance Group Water Booster 2.0 Kw (tested to NZHHA Max output) part#123699. Any other Water Booster will nullify the Reliance Group Warranty

**Note** Overall flue system length for optimum performance should be between 3600-4200 long, vertical and have no bends. Flue pipes should be Ø150mm (Ø6") Deviation from this may alter heater performance and may nullify the Reliance Group warranty if the flue is excessively long or short. If in doubt contact your Jayline supplier. Stainless steel deflector tested on this unit.

A provision has been made at the rear of the pedestal for seismic restraint by bolting through the two holes provided

Hearth specs (NZ) minimum Ash Hearth only e.g ceramic tiles glued to a heat sensitive floor.